




Wood scaffold erection guidelines

General requirements

- Wood scaffolding must be built using No. 2 or better lumber (Douglas fir-larch, hemlock-fir, spruce-pine-fir, or coast-Sitka-spruce species). To eliminate split, warped, or otherwise defective lumber, scaffold materials should be hand-selected.
 - Progressively brace the scaffold as it is erected.
 - Make sure there is firm contact between bearer blocks, bearers, wall scabs, and ledgers to provide maximum strength at connecting points.
 - The number and size of nails and nailing patterns at connections should be consistent with good practice. As a guide, nails should protrude at least two-thirds of the thickness into the adjoining piece of lumber.
 - When holding power is critical, or when the scaffold will be used for an extended length of time, dip-galvanized or spiral nails should be used. When scaffold components are intended to be dismantled and reused, double-headed nails may be used.
- CAUTION:** Do not use the same nail holes on reassembly.
- Do not exceed the maximum allowable dimensions for bearers and upright spacing.
 - Do not overload the scaffold.
 - The spacing of vertical supports (uprights) and bearers must not exceed 3 m (10 ft.).

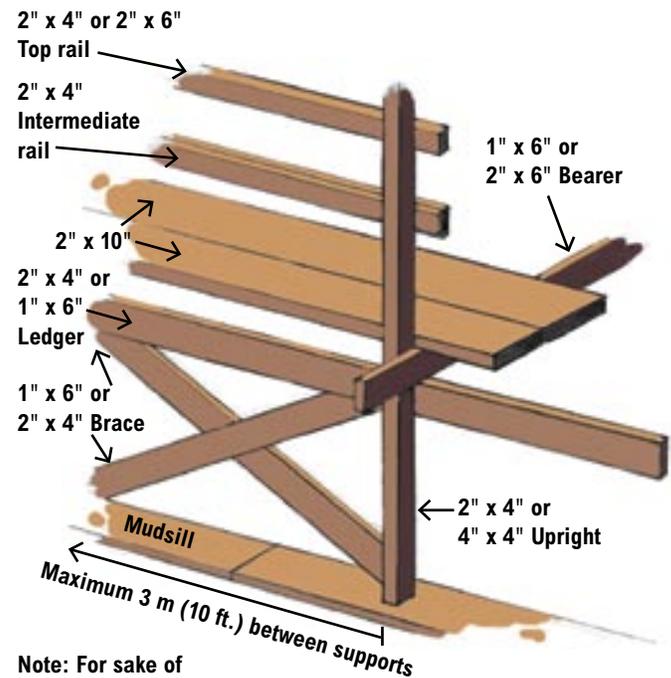

Note: For sake of drawing clarity, toeboards are not shown.

Project: _____ Address: _____

Employer: _____ Supervisor: _____

Date: _____ Time: _____ Shift: _____

Number in crew: _____ Number attending: _____

Other safety issues or suggestions made by crew members:

Record of those attending:

Name: (please print)	Signature:	Company:
1.		
2.		
3.		
4.		
5.		
6.		
7.		
8.		
9.		
10.		
11.		
12.		
13.		
14.		
15.		

Manager's remarks: _____

Manager: _____ Supervisor: _____

(signature)

(signature)



WORKING TO MAKE A DIFFERENCE
worksafebc.com